


43A4146/1
(L-881: 2 - BOX EXTERNAL WIRING)

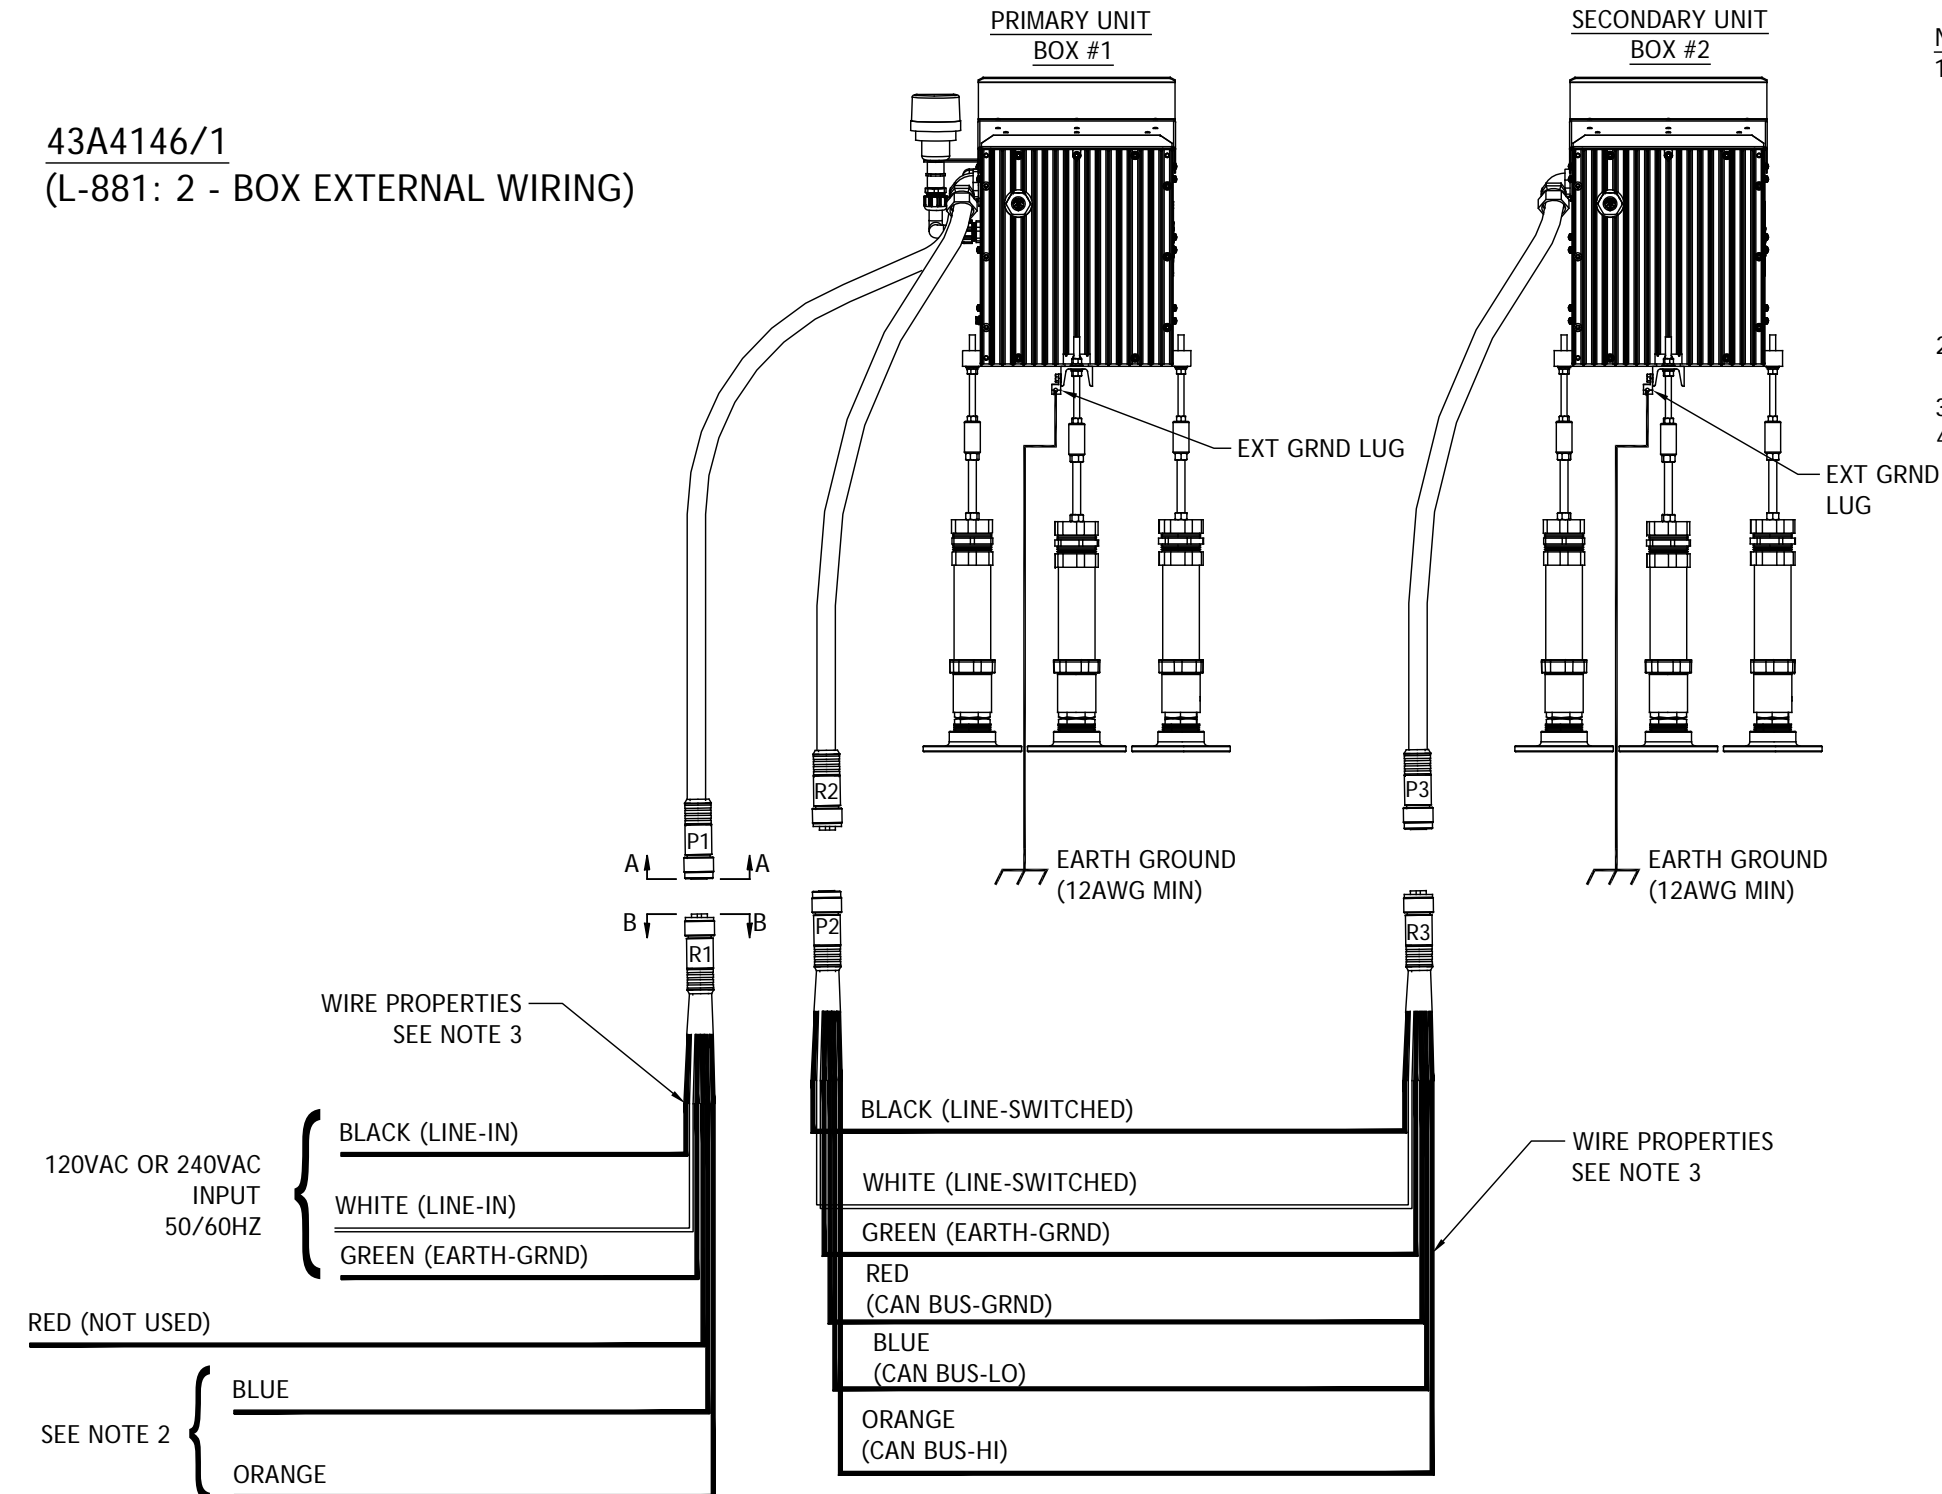

- NOTES:**
1. PLUG AND RECEPTACLE DESIGNATIONS (SEE TABLE 1):
 P1=PLUG, INPUT POWER (PRIMARY UNIT ONLY).
 R1=RECEPTACLE, INPUT POWER (PRIMARY UNIT ONLY).
 P2=PLUG, SYSTEM SWITCHED POWER AND COMMUNICATIONS (PRIMARY UNIT ONLY).
 R2=RECEPTACLE, SYSTEM SWITCHED POWER AND COMMUNICATIONS (PRIMARY UNIT ONLY).
 P3=PLUG, SYSTEM SWITCHED POWER AND COMMUNICATIONS.
 R3=RECEPTACLE, SYSTEM SWITCHED POWER AND COMMUNICATIONS .
 2. BLUE AND ORANGE WIRES ARE DESIGNATED FOR CURRENT SENSE OR REMOTE-ON OPTIONS.
 3. ALL WIRES 16AWG AND 600V, PER NEC AND LOCAL CODES.
 4. WIRE SPLICING AND CONNECTIONS MUST BE DONE PER ADB FIELD CRIMP DOCUMENT Q4XXXX.


TABLE 1: CORDSET 1, 2 AND 3 - P/N REFERENCE (SEE NOTE 1)

CORDSET TYPE	REF ADB P/N	DESCRIPTION
P1 AND P3	73A0130/8	6-COND MALE CONNECTOR W/ 8' CORD (16AWG)
P2	73A0130	6-COND MALE CONNECTOR W/ 6' CORD (16AWG)
R1 AND R3	73A0129	6-COND FEMALE CONNECTOR W/ 6' CORD (16AWG)
R2	73A0129/8	6-COND FEMALE CONNECTOR W/ 8' CORD (16AWG)

43A4146/X
 1 = 2-BOX (L-881) WIRING
 2 = 4-BOX (L-880) WIRING


TABLE 2:CORDSET 1, 2 AND 3 - PIN-OUT

PIN #	WIRE-COLOR
1	WHITE
2	RED
3	GREEN
4	ORANGE
5	BLACK
6	BLUE

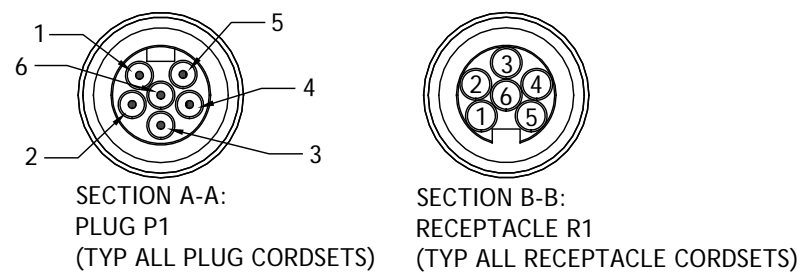

CONTROLLED COPY			
Unauthorized duplication of this document in whole or part is prohibited. Initialed in RED ink below indicates authorized copy.			
INITIAL & DATE: _____			
ADBE			
ADB Airfield Solutions P.O. Box 30829 Tel: (614) 861-1304 977 Gahanna Parkway Fax: (614) 864-2069 Columbus, OH 43230			
DRAWING TITLE: COMMERCIAL LED PAPI: EXTERNAL WIRING DIAGRAM VOLTAGE DRIVEN UNITS (STYLE A) L-880 AND L-881			
REV	ECO	REVISION DESCRIPTION	DRAWN BY
A	----	INITIAL LAYOUT	WH 15JAN13
LEVEL	NUMBER	DATE	DATE
ASSOCIATED DRAWINGS:	DRAWN BY:	DRAWN DATE:	
43A4144/X	WHALLAM	15 JAN 2013	
Information contained on this drawing is to be used expressly in accord with purpose for which it was submitted. Any disclosure of this information is strictly prohibited except as ADB Airfield Solutions, Inc. may otherwise agree in writing. Copyright © 2011 ADB Airfield Solutions.			
DRAWING NUMBER: 43A4146/X			REV: A

43A4146/2
(L-880: 4 - BOX EXTERNAL WIRING)

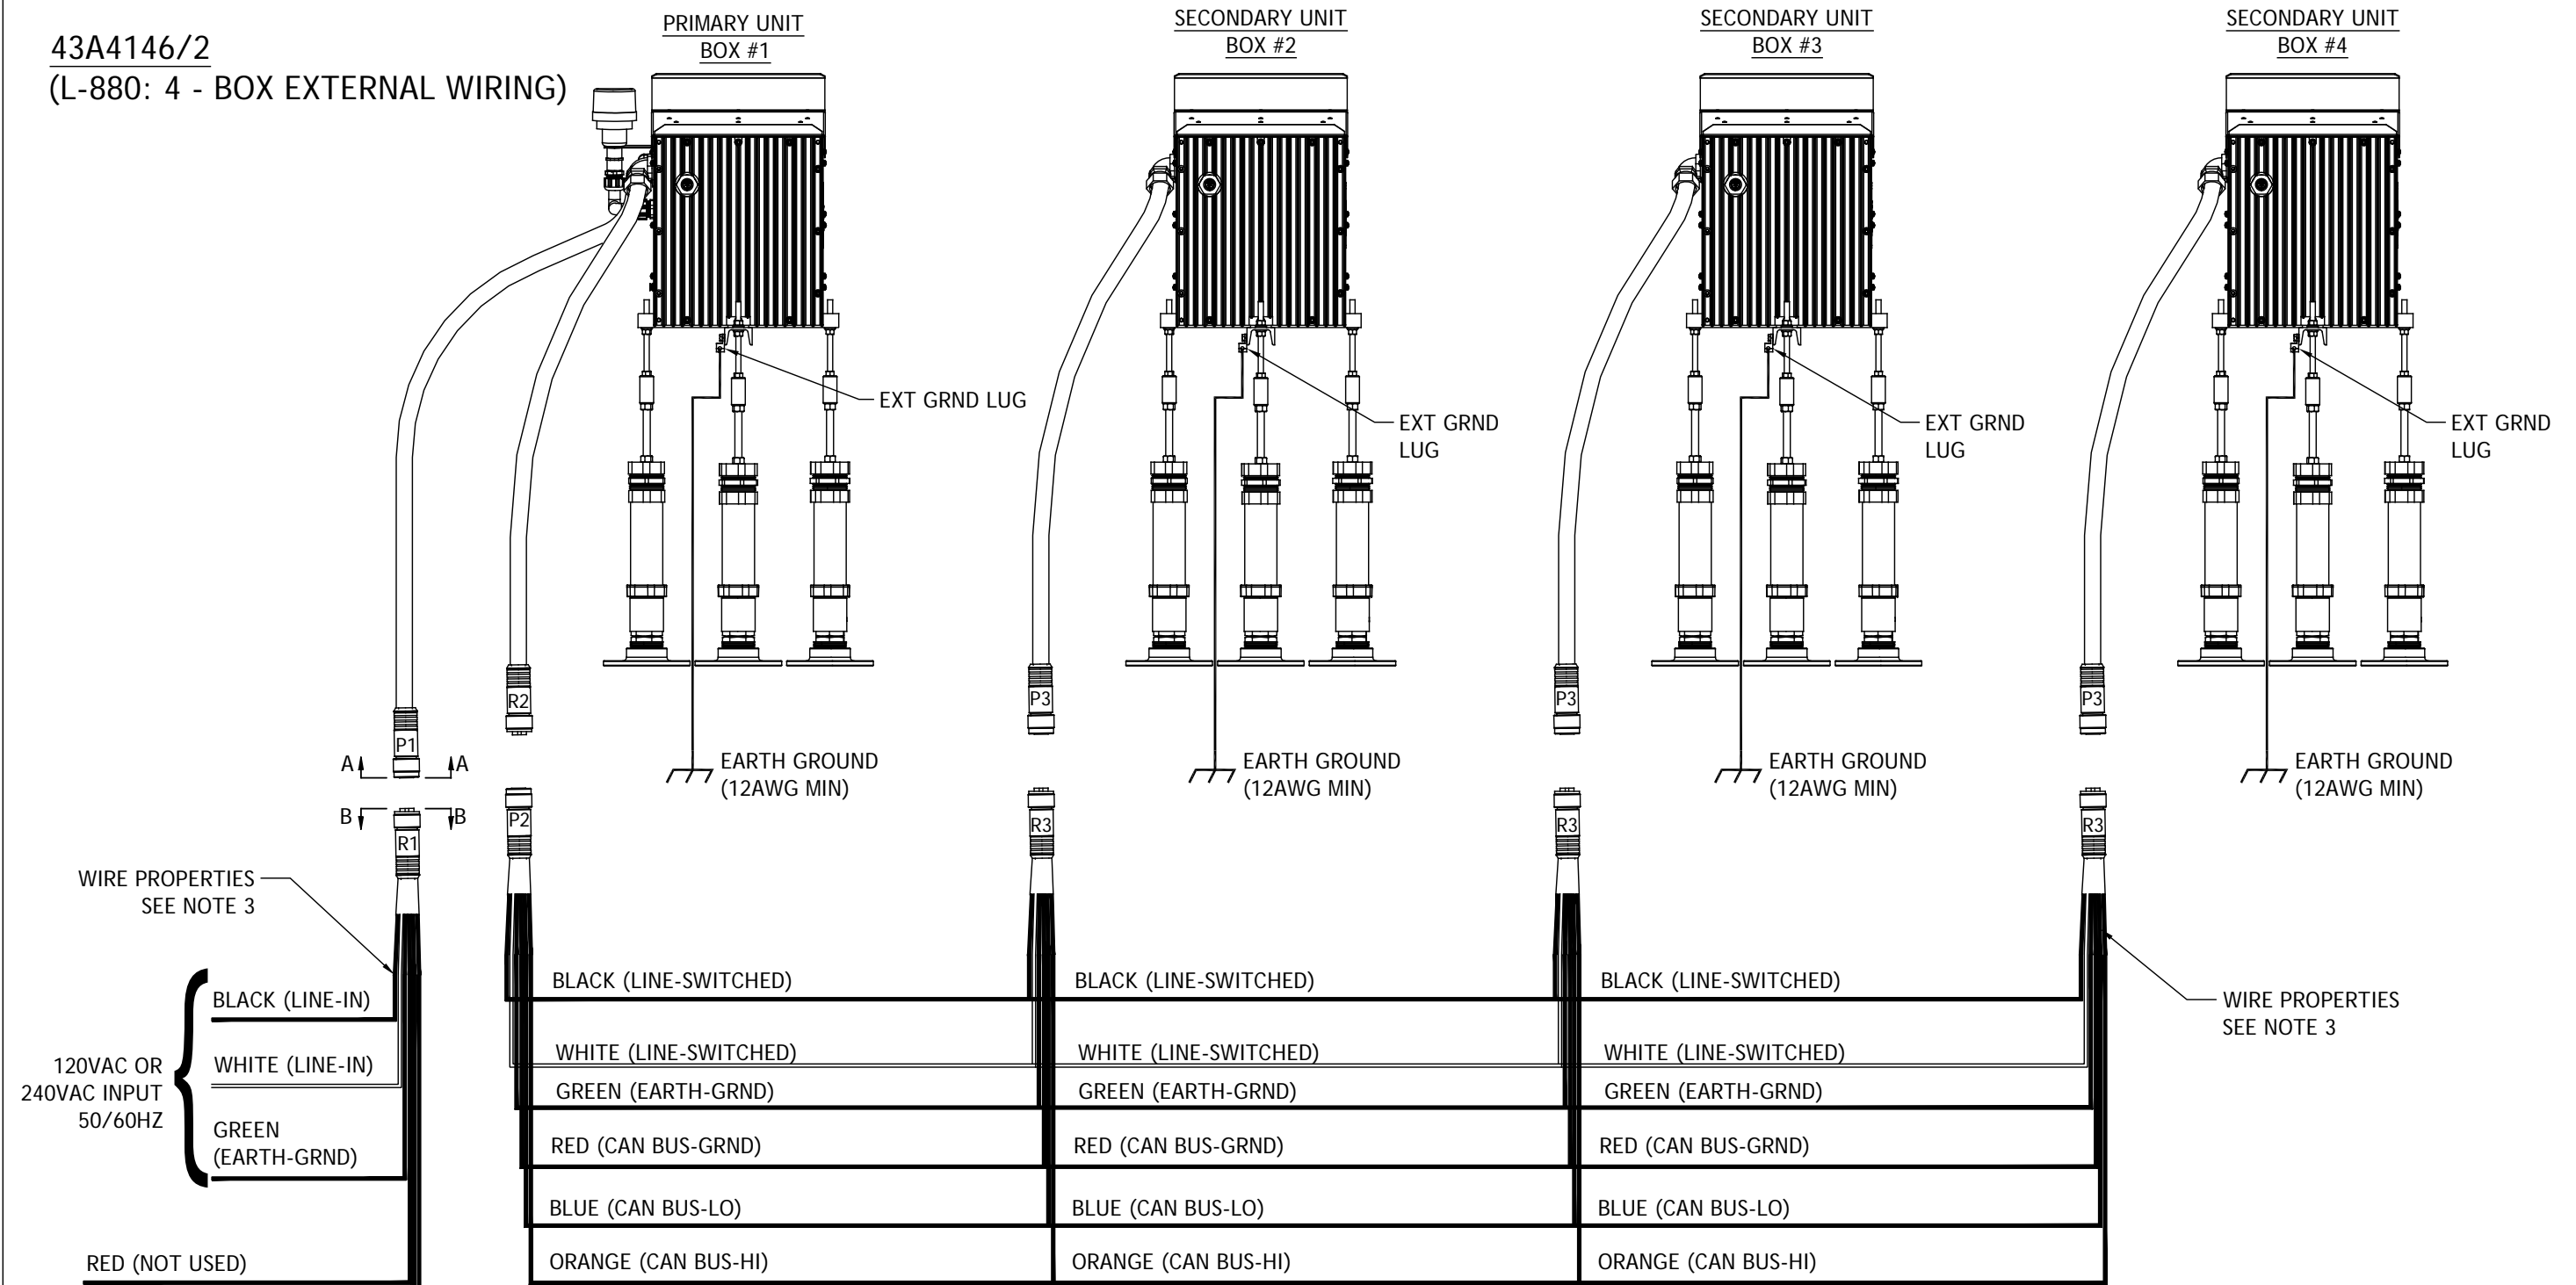

WIRE PROPERTIES
SEE NOTE 3

120VAC OR
240VAC INPUT
50/60HZ


RED (NOT USED)

SEE NOTE 2


BLUE
ORANGE

TABLE 2: CORDSET 1, 2 AND 3 - PIN-OUT

PIN #	WIRE-COLOR
1	WHITE
2	RED
3	GREEN
4	ORANGE
5	BLACK
6	BLUE

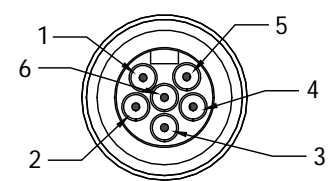

SECTION A-A:
PLUG P1
(TYP ALL PLUG CORDSETS)



SECTION B-B:
RECEPTACLE R1
(TYP ALL RECEPTACLE CORDSETS)

CONTROLLED COPY			
Unauthorized duplication of this document in whole or part is prohibited. Initialed in RED ink below indicates authorized copy.			
INITIAL & DATE:			
ADB			
ADB Airfield Solutions P.O. Box 30829 Tel: (614) 861-1304 977 Gahanna Parkway Fax: (614) 864-2069 Columbus, OH 43230			
DRAWING TITLE: COMMERCIAL LED PAPI: EXTERNAL WIRING DIAGRAM VOLTAGE DRIVEN UNITS (STYLE A) L-880 AND L-881			
REV	ECO	REVISION DESCRIPTION	WHH
LEVEL	NUMBER		DATE
A	----	INITIAL LAYOUT	15JAN13
ASSOCIATED DRAWINGS:		DRAWN BY:	DRAWN DATE:
43A4144/X		WHALLAM	15 JAN 2013
Information contained on this drawing is to be used expressly in accord with purpose for which it was submitted. Any disclosure of this information is strictly prohibited except as ADB Airfield Solutions, Inc. may otherwise agree in writing. Copyright © 2011 ADB Airfield Solutions.			
DRAWING NUMBER: 43A4146/X			REV: A